

EXITGUARD EX125iS-HX

The EX125iS-HX EXITGUARD is a self contained simple to operate solution for the 24 hour protection of fire exit and other doors.

It is specifically designed to monitor a door contact with end of line resistors (2k2/4k7) and provide resistor biased outputs to allow the EXITGUARD to be monitored by a suitable intruder panel. Selectable resistors allow the outputs to be configured for different intruder panels.

General Operation

The EX125iS-HX is controlled using the built in key switch. With the OP1 mode switch switched to LO, when the keyswitch is in the OFF position, the protected door maybe opened without generating any form of alarm. With the OP1 mode switch, switched to the HI position, when the keyswitch is in the OFF position, the protected door maybe opened without generating a local alarm, but OP1 will signal as alarm. (This is useful if the monitored door is programmed as final exit on an intruder panel, then the OP1 follows the door opening and closing to set the control panel). If the key switch is in the ON position, opening the door will result in a high powered audible alarm from the EXITGUARD, the units two LEDs will also flash. Additionally the alarm output (OP1) will also provide an alarm condition to an intruder panel. Once in alarm, the only way to reset the EXITGUARD is to turn the keyswitch to the OFF position.

Bleep In Off function

The EX125iS-HX includes the Bleep In Off function which while the keyswitch is in the OFF position, causes the EXITGUARD to bleep and flash its LED every 60 seconds. Every ten minutes that the EXITGUARD is left in the OFF position it will also briefly play a louder tone.

The Bleep In Off function can be turned on or off using the BIO switch on the PCB.

Alarm Auto Reduction

Once the alarm is activated, it will sound continuously whilst the door is open, but after the alarm has been sounding for approx. 1 minute with the door closed, the alarm sounder will reduce to a tone every 30 seconds. During the reduced alarm the LEDs will continue to flash. The OP1 will clear during reduced alarm. Should the door be re-opened during the reduced alarm, the OP1 will switch and the full alarm sounder will activate again.

Safe Set

To prevent accidental alarm activations, the EX125iS-HX incorporates a safe set feature. If the keyswitch is moved from the OFF position to the ON position while the door is open, a constant tone will be heard and the alarm output OP1 will not change state. If the door is closed within the next 15 seconds and the EXITGUARD will set without having to move the keyswitch back to the OFF position. However if the door remains open beyond the 15 seconds, the EXITGUARD will go into full alarm and the alarm output OP1 will change to the alarm state.

Keyswitch On / Off Monitoring

The EX125iS-HX provides a second output OP2 which can be monitored by an intruder panel. This output indicates the status of the keyswitch. With the keyswitch in the ON position, the normal state is indicated. If the keyswitch is in the OFF position, the alarm state is indicated.

Box Tamper

If the box lid is opened OP2 provides a tamper to the intruder panel by going open circuit.

Door Contact Tamper

If the door contact is tampered when the keyswitch is in the ON position, the EXITGUARD will play a continuous tone and OP1 will change to the alarm state. If the keyswitch is in the OFF position, a door contact tamper will just change OP1 to the alarm state but no alarm tone will be heard.



DWG 60210

Hoyles Electronic Developments Ltd

Sandwash Close, Rainford, St Helens, WA11 8LY, UK
www.hoyles.com
sales@hoyles.com
+ 44 (0) 1744 886600



Output resistors

The two outputs OP1 and OP2 both have two sets of resistor combinations selectable by the four jumpers, J1, J2, J3 and J4 on the PCB. With all four jumpers in position A, the alarm resistor is 1K and the EoL resistor is also 1k for both OP1 and OP2. With all four jumpers in position B, the alarm resistor is 4K7 and the EoL resistor is 2k2 for both OP1 and OP2.


Other resistor combinations to suit other intruder panels are available on request.

Alarm Tones

The EX125iS-HX has two selectable alarm tones available, a high powered tone and a low powered tone. The required tone can be selected by switching the TONE switch on the PCB into either the HI or LO position.

Power requirements - A continuous supply of 12vdc is required, 15mA max quiescent and 150mA max in alarm.

Connection Details

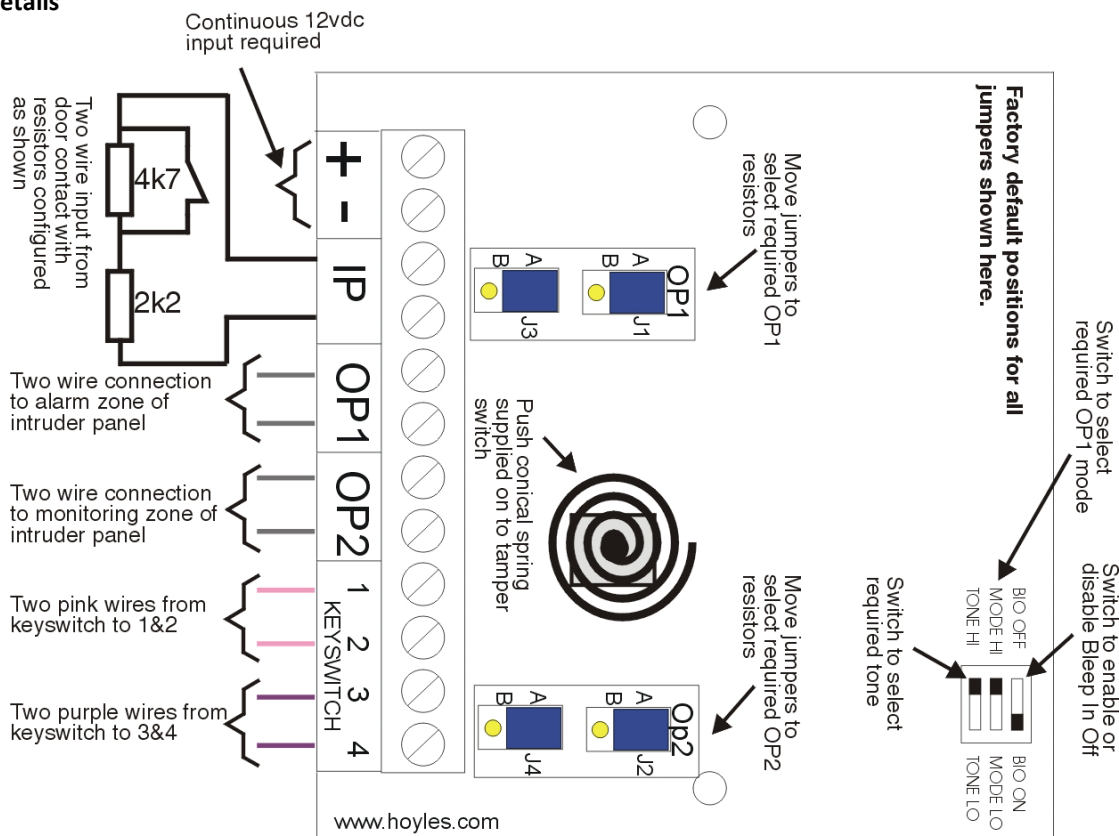

Cause and Event Table

The table shows the possible events based on the available causes.

Causes				Events		
Keyswitch	Door Contact	Box Tamper	J2	Sounder	OP1	OP2
Off	Normal	Closed	Hi	Off or Bleep	Normal	Alarm
Off	Alarm	Closed	Hi	Off or Bleep	Alarm	Alarm
Off	Alarm or Normal	Closed	Lo	Off or Bleep	Normal	Alarm
Off	Alarm or Normal	Open	Lo	Off or Bleep	Normal	O/C Fault
Off	S/C or O/C Fault	Closed	Hi or Lo	Off or Bleep	Alarm	Alarm
Off	S/C or O/C Fault	Open	Hi or Lo	Off or Bleep	Alarm	O/C Fault
On	Normal	Closed	Hi or Lo	Off	Normal	Normal
On	Normal	Open	Hi or Lo	Off	Normal	O/C Fault
On	Alarm	Closed	Hi or Lo	On	Alarm	Normal
On	Alarm	Open	Hi or Lo	On	Alarm	O/C Fault
On	S/C or O/C Fault	Closed	Hi or Lo	On	Alarm	Normal
On	S/C or O/C Fault	Open	Hi or Lo	On	Alarm	O/C Fault

Note: When jumpers for OP1 and OP2 are all set in position A, Normal = 1k and Alarm = 2k (1k+1k)

When jumpers for OP1 and OP2 are all set in position B, Normal = 2k2 and Alarm = 6k9 (2k2+4k7)